

Assessment of hydraulic performance and inequalities in access to the Yopougon-Koweït drinking water supply network (Abidjan, Côte d'Ivoire)

ABSTRACT

The drinking water supply in the Yopougon-Koweït neighborhood faces challenges in terms of accessibility and performance of the drinking water supply network. This study aims to evaluate the hydraulic performance of the drinking water supply network in the Yopougon-Koweït neighborhood in Abidjan. The methodological approach is based on data relating to water production and water demand from the population, collected by SODECI in 2010, 2015, and 2022. The results reveal a significant but incomplete improvement in access to drinking water. The access rate rose from 39% to 68% between 2015 and 2022. Analysis of the state of the network highlights its aging and poor hydraulic performance, despite progress. The network's efficiency improved from 32% to 62%. Linear losses have been reduced from 88 to 28 m³/day/km. However, the network has a very heterogeneous and fluctuating pressure profile, ranging from -1.25 to 32.1 mCE. This situation creates inequalities in access between sub-neighborhoods.

Keywords: Water supply network, water drinking, hydraulic performance, Yopougon-Koweït

INTRODUCTION

Water is an indispensable element for sustaining life and maintaining good health. It is now widely acknowledged as a fundamental human right (Yao, 2022). It is evident that Sustainable Development Goal 6 (SDG 6) has been instrumental in guiding the United Nations (UN) towards its commitment to ensure universal access to water and sanitation by 2030, in addition to promoting sustainable water resource management (UN Water, 2023).

In sub-Saharan Africa, approximately 30% of the urban population resides in informal settlements (WHO/UNICEF, 2023). As stated by UN Water (2019), inhabitants of such settlements frequently encounter difficulties in accessing fundamental amenities, including potable water. This situation is evident in Côte d'Ivoire, a developing country where populations still have insufficient access to safe drinking water. This is in spite of the fact that acceptable coverage rates have been achieved.

Abidjan, the largest city in Côte d'Ivoire and the fourth largest in Africa, is no exception in terms of the difficulty of accessing water (Goé et al., 2024 ; Goé et al., 2025). It is estimated that this region is home to over 30% of the Ivorian population, and it has an annual growth rate of 2.9% (INS, 2021). Despite constituting less than 1% of the national territory, it is responsible for 60% of Côte d'Ivoire's total drinking water production and consumption. In 2020, the volume of water produced in Côte d'Ivoire was 302,814,000 m³, of which 227,668,000 m³ was billed, resulting in a loss of 7,514,600 m³ (ONEP, 2020).

The Koweït neighbourhood, the setting for this study, has a population of 46,932, comprising 7,822 households, with an average household size of 6 people (INS, 2021). The population subscribing to RéPEP is estimated at 5,483 (SODECI, 2022). In the context of inadequate water infrastructure, households have been observed to adopt alternative strategies to compensate for the inconsistency of supply (Angueletou-Marteanu, 2009).

Indeed, a survey revealed that 59% of households obtained their water supply from resellers who had connected illegally and were therefore not billed by SODECI.

However, this method of supply carries risks of water contamination linked to the quality of the pipes used, water collection, transport, and storage at home (Konan et al., 2011). The average cost of households' compensatory strategies is five times higher than their quarterly water bill, representing at least 10% of their monthly income (Angueletou-Marteau, 2009).

A study conducted in 2010 on network performance in the same neighbourhood demonstrated that for a daily water production of 2,450 m³, a mere 706 m³ was billed, representing a loss of 61% of the water supplied. This loss was attributable to 59% of households that obtained their water exclusively and fraudulently from resellers. This has resulted in considerable financial losses for the water sector, estimated at 169,190,525 CFA francs per year (Touré et al., 2013). It is vital to acknowledge the significance of access to water for the population of Yopougon-Kowéït in order to ensure their well-being. Therefore, the primary objective of this study is to evaluate the performance of the drinking water network in the Yopougon-Kowéït neighbourhood. This will ensure sustainable access to water for the population of that neighbourhood.

2. MATERIAL AND METHODS

2.1 Study area

The Yopougon-Kowéït neighbourhood is located in southern Côte d'Ivoire, between longitudes 4°3'0" and 4°3'36" West and latitudes 5°18'15"N and 5°19'20" N (see Figure 1). The area under consideration is 1.7 km², and the population is estimated to be 46,932 inhabitants (INS, 2021).

Yopougon-Kowéït is bordered to the north by the Toit Rouge neighborhood, to the south by the Ebrié lagoon, to the east by Santé neighborhood, and to the west by Camp Militaire neighborhood. It is subdivided into five sub-neighbourhoods: Johannesburg to the north, Ravin to the northeast, Konan Ferrand and Santé Extension to the southwest, and Sous-Kowéït and Gouro to the southeast.

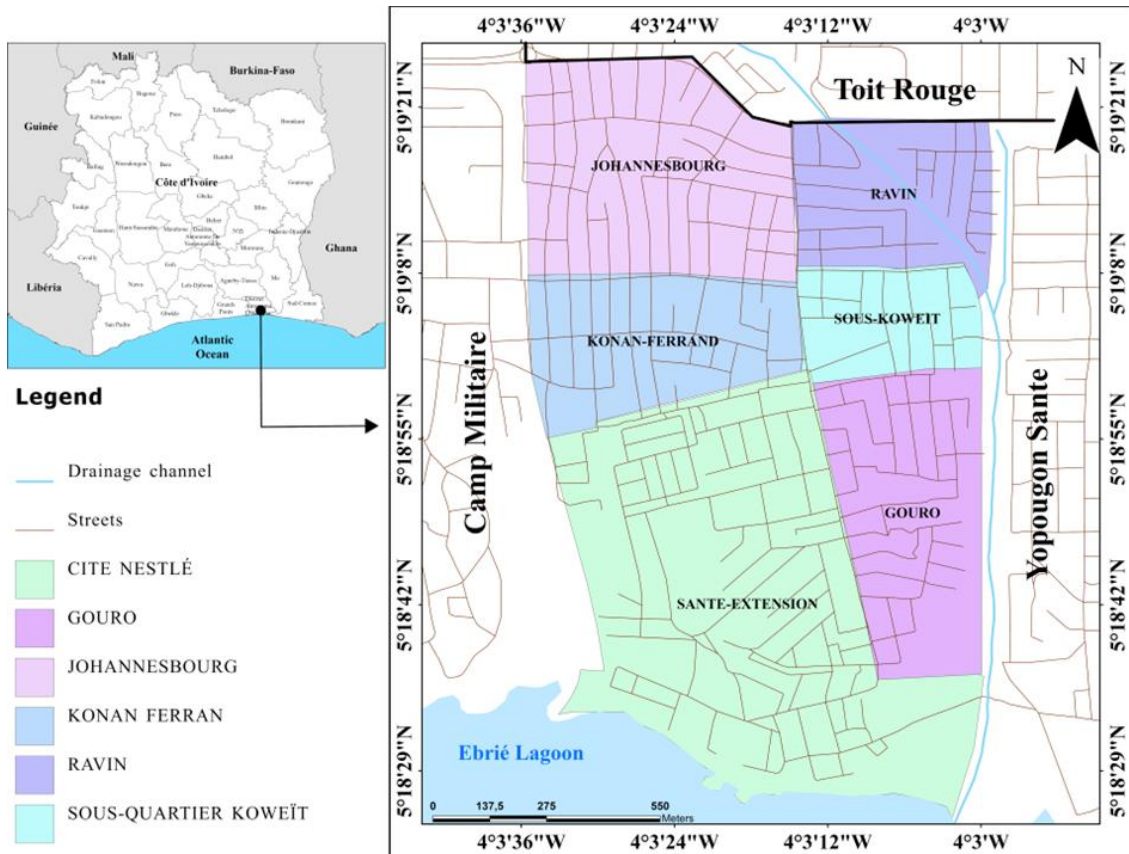


Figure 1: Study area

2.2 Data

This study required sociodemographic data and data on drinking water supply. The latter included the number of subscribers, cancellations, and the volumes distributed, consumed, and billed for the years 2010, 2015, and 2022. Field surveys were conducted using an interview guide, while data processing and analysis were performed using Excel 2013 software.

2.3 Methodes

2.3.1 Evaluation of subscriber density

Subscriber density is a metric that quantifies the number of subscribers per unit of network length. The application under discussion enables the distribution of subscribers across the water distribution network to be assessed, and the network to be characterized in terms of urban planning. This density is expressed in subscribers per kilometer (subscribers/km). The calculation is derived from the following equation:

$$D = \frac{\text{number of subscribers}}{\text{network length}} \quad (\text{Eq 1})$$

2.3.2 Estimation of domestic water consumption in the neighborhood

Population consumption was calculated based on specific consumption obtained from water volumes billed in 2015 and 2022. Specific consumption (equation 2) is calculated from billed volumes using the Krayenbuhl formula (1993):

$$SC = \frac{V_c}{365 \times T \times A} \quad (\text{Eq. 2})$$

Avec :

SC : Specific consumption ;

V_c : Annual water volume consumed ;

T : Average household size ;

A : Number of subscribers.

2.3.3 Estimation of water loss

The approach consisted of comparing daily consumption data determined from the volume of water consumed supplied by SODECI with the daily volume of water produced. This method made it possible to evaluate the performance of the Yopougon-Kuwait water supply system.

2.3.4 Performance indicator assessment

○ Technical network efficiency or billing ratio

The technical efficiency of the drinking water network is an indicator that measures the efficiency and performance of the network. This ratio is defined as the proportion of water consumed by subscribers relative to the total water input into the network, as depicted in equation 3 (Hugues, 2000). This is denoted by the letter η and expressed as a percentage (%).

$$\eta = \frac{\text{consumed volume}}{\text{distributed volume}} \times 100 \quad (\text{Eq. 3})$$

○ Linear consumption index (LCI)

It represents the total volume of consumers per linear meter of pipes. It is expressed in cubic meters per day per kilometer (m³/day/km) and is used to classify the type of network. In this study, it is given by the following equation (4) (Demassue, 1994):

$$LCI = \frac{\text{consumed volume}}{\text{network length} \times 365} \quad (\text{Eq. 4})$$

○ Linear loss index

The linear loss index is a performance indicator for drinking water distribution networks. It is expressed in cubic meters per day per kilometer (m³/day/km). Knowledge of this index makes it possible to better target the sections to be examined as a priority. It is given in this study by equation 5 (Demassue, 1994):

$$LLI = \frac{\text{Volume released for distribution} - \text{consumed volume}}{\text{network length} \times 365} \quad (\text{Eq. 5})$$

2.3.5 Evaluation of indicators for the operation of the drinking water supply network

○ Water access rate

The rate of access to drinking water represents the proportion of the population with regular access to a water source of sufficient quality to meet their basic needs. It is the ratio between the population with effective access to drinking water and the total population of the area. It is expressed according to equation 6 (MINHAS, 2021):

$$Ta = \frac{\text{Number of subscribers} \times \text{house hold size}}{\text{Total population covered}} \times 100 \quad (\text{Eq. 6})$$

○ **Cancellation rate**

This indicator refers to the proportion of households that voluntarily and formally disconnect from the distribution network. This is generally due to economic factors (financial insecurity, prohibitive cost of service) or technical factors (recurring service failures). This indicator reflects both supply failures and inequalities in access to an essential resource. It is the ratio between the number of subscribers who have terminated their service and the number of actual connections in the locality in question. In this study, it is given by the following formula, equation 7 (MINHAS, 2021):

$$Cr = \frac{\text{Number of subscribers canceled}}{\text{Total number of actual connections}} \times 100 \quad (\text{Eq. 7})$$

○ **Desert rate**

The capacity of the water supply system to provide safe drinking water to the population is measured by this indicator. The ratio between the volume of safe drinking water supplied to the inhabitants of a given locality and their safe drinking water needs is a key indicator of water supply efficiency. The term is defined in equation 8 (MINHAS, 2021):

$$Dr = \frac{\text{Supplied volume}}{\text{Demand}} \times 100 \quad (\text{Eq. 8})$$

In the domain of urban hydraulics, the volume of water supplied is determined as the difference between average daily production (m³/day) and average loss (m³/day).

○ **Number of hours of service or number of hours of coverage of the demand**

This indicator quantifies the mean service time, or the mean duration of supply over a 24-hour period. This calculation is derived from equation 9 (MINHAS, 2021):

$$Nh = \frac{\text{Supply}}{\text{Demand}} * 24 \quad (\text{Eq. 9})$$

○ **Production deficit rate**

The production deficit rate measures the proportion of the production deficit in relation to the overall drinking water demand of the population in the area under consideration. It is the ratio between the production deficit and the total demand of the locality under consideration. It is given in this study by equation 10 (MINHAS, 2021):

$$PDr = \frac{\text{Total demand (m}^3/\text{d)} - \text{current production (m}^3/\text{d)}}{\text{Total demand (m}^3/\text{day)}} \times 100 \quad (\text{Eq. 10})$$

○ **Measurement of pressures on the drinking water supply network**

The portable flow meter (Sewerin) and pressure sensors (Cello 4s) were utilized to assess flow rates and pressure at sector meters and at specific nodes within the sub-district network of the study area (see Figure 2).



Figure 2. Field equipment

a) The Flowmeter (Cewerin) ; **b)** Pressure sensors (Cello 4^s)

3. RESULTS AND DISCUSSION

3.1. Density of subscribers in Yopougon-Koweït

○ Evolution of the number of subscribers

The primary source of drinking water for the population of Yopougon-Kuwait is the public drinking water network (SODECI). Initiatives such as the URBIS project, the Emergency Urban Infrastructure Project, the Abidjan Restructured Neighborhoods Development Project, and the Drinking Water for All Project, which have been implemented in the neighborhoods since 2006, have contributed to enhancing access to drinking water for the population. The number of subscribers increased from 18 in 2006 to 5,438 in 2022 (see Table I). From 2010 to 2022, the subscription rate in the Yopougon-Koweït neighborhood exhibited a substantial increase of 53%.

Table I. Evolution of the number of subscribers in Yopougon-Koweït (Abidjan District), Côte d'Ivoire)

Years	2006	2010	2015	2022
Subscribers	18	2863	2588	5483

○ Subscriber density analysis

Subscriber density is indicative of the number of households connected to RéPEP per unit of area. The number of subscribers per kilometer increased from 154 in 2010 to 167 in 2022, but decreased to 139 in 2015 (see Table II).

Table II. Evolution of the subscriber density in Yopougon-Koweït

Years Indicators	2010	2015	2022
Subscriber density (subscriber/km)	154	139	167

As illustrated in Figure 3, the Johannesburg sub-neighbourhood (1,840 subscribers) exhibits the highest concentration of subscribers. The Sante extension sub-neighbourhood, with a subscriber base of 975, is noteworthy as the second most connected area. The Konan Ferrand (767 subscribers), Gouro (714 subscribers), and Koweït (710 subscribers) sub-

neighbourhood demonstrate moderate coverage. The Ravin area (540 subscribers) appears to be the least connected.

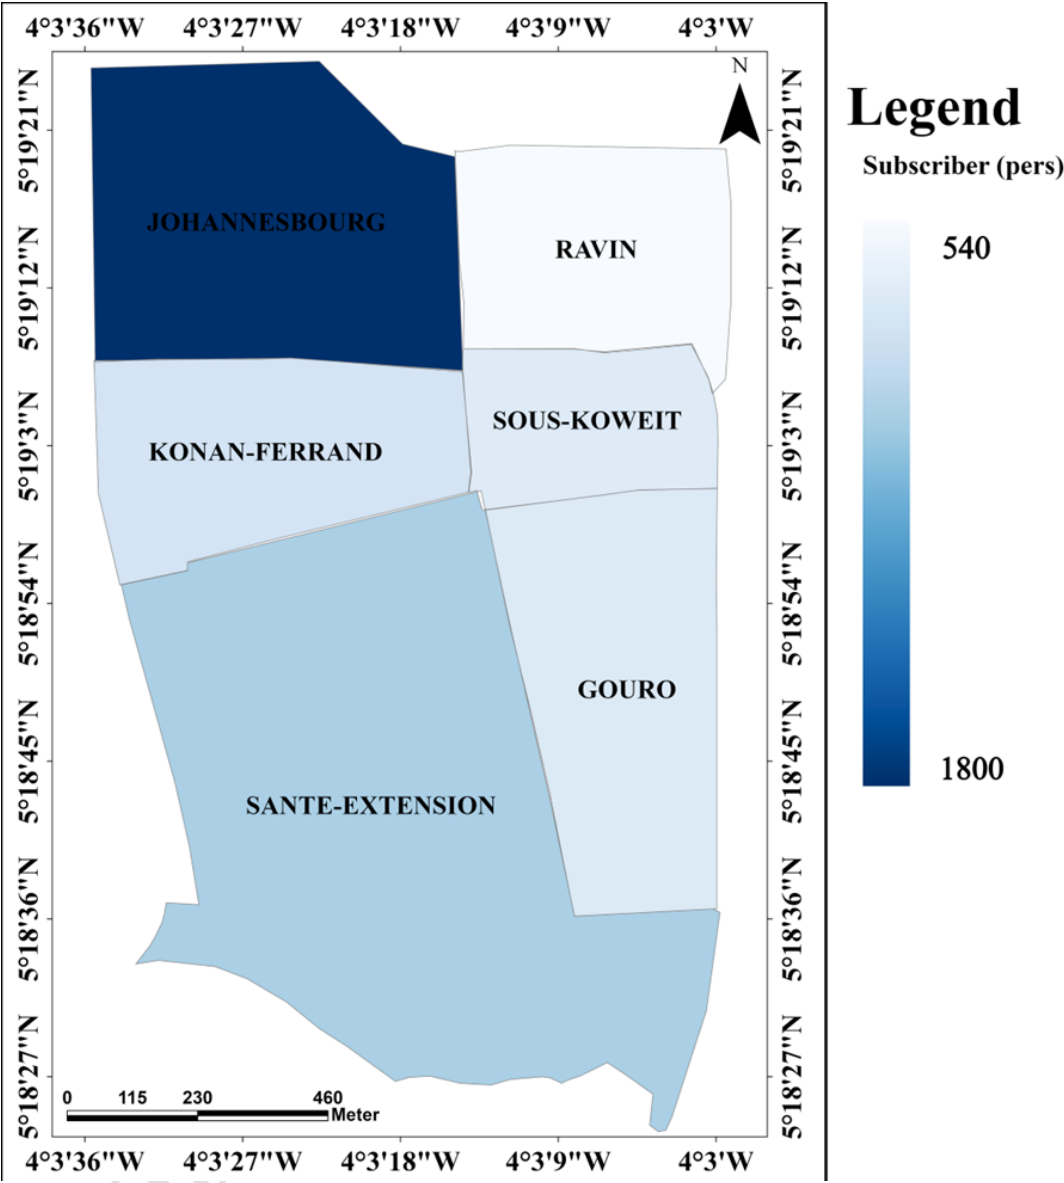


Figure 3. Density map of subscribers in Yopougon-Koweït

3.2. Household water consumption of the population

Water consumption in the Yopougon-Koweït neighborhood, based on SODECI data from 2010, is 300,957 m³/year and 542,259 m³/year in 2022. The number of subscribers billed rose from 2,863 in 2010 to 5,483 in 2022. The average household size remains unchanged and is estimated at six people per subscriber. This leads to a specific consumption of 48 L/day/resident in 2010, compared to 55 L/day/resident in 2015 and 45 L/day/resident in 2022 (Table III). In addition, the average domestic water consumption of a subscriber in the Yopougon-Koweït neighborhood is 247 L/day/subscriber in 2010, compared to 330 L/day/subscriber in 2015 and 271 L/day/subscriber in 2022.

Table III. Evolution of billed water volumes and specific consumption

Years	2010	2015	2022
Volume of water consumed (m ³ /year)	300 957	311 723	542 259
Specificconsumption (L/day/resident)	48	55	45

Figure 4 shows that the Johannesburg sub-neighborhood (202,760 m³) stands out clearly as the area with the highest water consumption. The Konan Ferrand (89,720 m³), Koweït (68,996 m³), Ravin (65,772 m³), and Gouro (67,958 m³) sub-neighborhoods have moderate consumption levels. The Sante extension sub-neighborhood (70,099 m³) is slightly above the lower threshold, but remains within a lower range than the others.

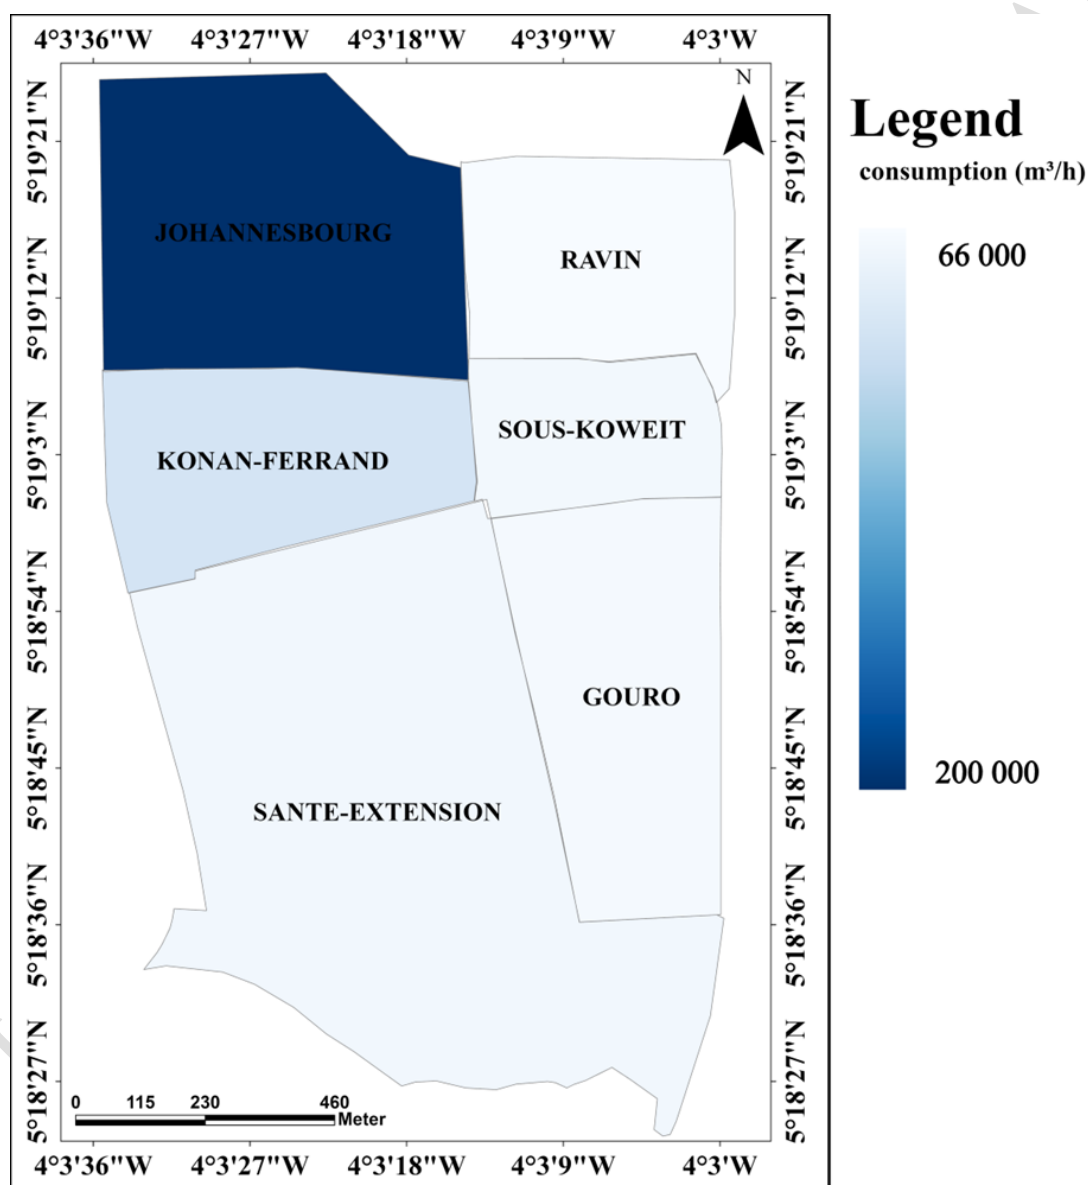


Figure 4. Consumption density map of Yopougon-Koweït

○ Evolution of the specific consumption

Water consumption in the study area, based on SODECI data from 2010, is 300,957 m³/year and 542,259 m³/year in 2022. The number of subscribers billed was 2,863 in 2010 and 5,483 in 2022. The average household size remains unchanged and is estimated at 6 people per subscriber. This

leads to a specific consumption of 48 L/day/resident in 2010, compared to 55 L/day/resident in 2015 and 45 L/day/resident in 2022 (Table IV). In addition, the average domestic water consumption of a subscriber in Yopougon-Koweït is 247 liters per day (L/day/subscriber) in 2010, compared to 330 L/day/subscriber in 2015 and 271 L/day/subscriber in 2022.

Table IV. Evolution of billed water volumes and specific consumption

Years	2010	2015	2022
Volume of water consumed (m ³ /year)	300 957	311 723	542 259
Specific consumption (L/day/hbt)	48	55	45

3.3 Analysis of water losses

The estimate of water losses based on SODECI consumption data indicates that water losses increased from 706 m³/day in 2010 to 854 m³/day in 2015 and to 1,486 m³/day in 2022, representing a loss of 71%, 65%, and 38% of average daily production, respectively (Table V). Between 2010 and 2022, the average daily production decreased by 10% per year/day in 2022, representing losses of 71%, 65%, and 38% of average daily production, respectively (Table V). Between 2010 and 2022, there was a significant reduction in the loss rate in the Yopougon-Koweït neighborhood of 33%.

Table V. Assessment of water losses from 2010 to 2022

Years	2010	2015	2022
Volume of water consumed (m ³ /year)	888	854	1540
Water volume produced (m ³ /day)	2450	2440	2406
Water loss (m ³ /day)	706	854	1486
Loss rate (%)	71%	65%	38%

3.4 Network performance parameter analysis

As illustrated in Table VI, there has been an enhancement in the primary technical efficiency of the network from 2010 to 2022. The percentage increased from 32% to 62%. However, this efficiency falls short of the established standard of 80%. The linear consumption index exhibited stability, maintaining an average of 45 m³/day/km. The linear loss index exhibited a substantial improvement, decreasing from 88 m³/day/km in 2010 to 28 m³/day/km in 2022. However, this value is indicative of the substandard condition of the RéPEP.

Table II. Performance indicators for the RéPEP in Yopougon-Koweït

Years Indicators	2010	2015	2022
Technical efficiency (%)	32	35	62
Linear consumption index (m ³ /day/km)	44	46	45
Linear loss index (m ³ /day/km)	88	85	28

3.5 Drinking water supply network operating indicators

Table VII presents the operating indicators for the RéPEP in the Yopougon-Koweït neighborhood. The rate of access to drinking water for the populations of Yopougon-Koweït has improved significantly. It rose from 47% in 2010 to 68% in 2022, with a significant decline of 39% in 2015. The service rate rose from 23% in 2015 to 31% in 2022. These rates reflect the investments made in the urban water sector. The cancellation rate in 2010 and 2022

is virtually zero. In contrast, this rate rose by 10% in 2015. The number of hours of service is around 13 hours and remained relatively stable between 2010 and 2015. This number declined to 10 hours in 2022. In addition, the production deficit rate increased over the three (03) years. It rose from 32% in 2010 to 50% in 2022. This rate reveals a gap between the increase in production and the expansion of water service.

Table III : RéPEP operating indicators in Yopougon-Koweït

Years Indicators	2010	2015	2022
Access rate (%)	47	39	68
Cancelled rates (%)	0,3	10	0
Desert rate (%)	23	22	31
Number of hours of desert(H)	13	14	10
Production deficit rate (%)	32	38	50

○ Analysis of pressures on the Yopougon Kuwait network

The Yopougon-Kuwait network experiences significant pressure fluctuations (Figure 5). These vary from -1.25 mCE to 32.1 mCE and follow a daily cycle marked by two peaks (2 a.m. to 4 a.m. and 12 p.m. to 2 p.m.) and two low periods (7 a.m. to 9 a.m. and 4 p.m. to 7 p.m.). The distribution network shows significant spatial heterogeneity in pressure. It can be categorized into three distinct classes: (i) high-pressure areas, (ii) intermediate-pressure areas, and (iii) low-pressure areas.

The Johannesburg sub-neighborhood is the area under the most pressure and has the highest pressures in the network. These pressures range from 12 to 32.1 mCE at night (9 p.m. to 5 a.m.) and from 8 to 15 mCE during the day (6 a.m. to 8 p.m.). The Ravin and Konan Ferrand sub-neighborhoods are areas of intermediate pressure. Pressures in Ravin vary from 10 to 25 mCE at night and from 5 to 9 mCE during the day. In the Konan Ferrand sub-neighborhoods, pressures vary from 5 to 21 mCE at night and drop to a range of 2 to 7 mCE during the day. The Sous-Koweït, Gouro, and Sante Extension (Sikasso) sub-neighborhoods are low-pressure areas. In the Sous-Koweït area, the pressure, which is already low at night (1-7 mCE), drops to a very low level during the day (0-1 mCE). The situation is even more worrying in the Gouro and Sikasso sub-neighborhoods, which have virtually zero pressure both at night and during the day.

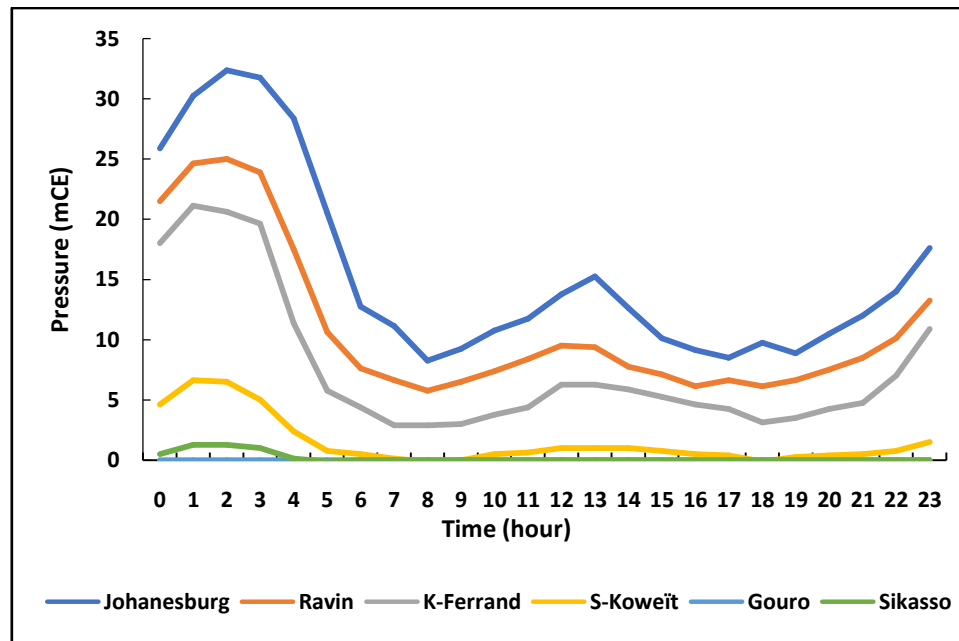


Figure 5. Pressure variations on the Yopougon-Koweït

3.1 Discussion

The study shows exponential growth in the number of subscribers in Yopougon-Koweït. This number rose from 18 in 2006 to 5,483 in 2022. This increase reflects the impact of government actions to improve access to drinking water for the population with a view to achieving SDG 6. Indeed, the rate of access to urban water supply rose from 80.7% in 2015 to 84% in 2020 (PND 2021). Conversely, specific consumption fell from 48 L/day/resident in 2010 to 45 L/day/resident in 2022. This decline has gone from 64.2 L/day/resident (Thompson et al., 2002) to 50-55 L/day/resident in 2023, due to demographic pressure and recurring shortages. Furthermore, this value is lower than the average consumption ratio set at 100 L/day/resident in the autonomous district of Abidjan (ONEP, 2020). However, this ratio masks disparities between different population groups' standards of living. Household daily drinking water consumption varies according to household income. It is 132 liters per person for high-income households and 88 liters per person for low-income households (Ta bi Boti et al., 2019).

In addition, the network's primary technical efficiency improved between 2010 and 2022, rising from 32% to 62%. The linear loss index also improved significantly, from 88 m³/day/km in 2010 to 28 m³/day/km in 2022. Subscriber density increased significantly, from 154 subscribers/km in 2010 to 167 subscribers/km in 2022. This improvement could be linked to the actions undertaken by SODECI in 2015 in the district of Abidjan. These actions consisted of pressure management, sectorization, active leak detection, replacement of old meters, modernization of metering, and the fight against fraud (N'cho, 2021). However, the study highlights the poor performance parameters of the Yopougon-Kuwait network, with efficiency below the standard set at 80% for good efficiency according to Blarel and Merzouk (2005). The same is true for the linear loss index, for which the recommended standard is less than 15 m³/day/km (ANBT, 2020). This poor network performance could be explained by its age (17 years on average) (Kleiner et al., 2001). Furthermore, according to Alegre et al. (2022), the aging of pipes significantly reduces the hydraulic performance of the RéPEP by altering the roughness of the walls.

Access to drinking water in Yopougon-Kuwait has improved significantly. It rose from 47% in 2010 to 68% in 2022, despite a significant drop of 39% observed in 2015. This significant decline in access to drinking water was caused by the consequences of the 2011 political crisis. This situation severely compromised water infrastructure and water sector governance in Côte d'Ivoire (Kouadio et al., 2017; AfDB, 2016). In addition, the service rate rose from 23% in 2015 to 31% in 2022. These access and service rates are in line with the targets set by the National Water Investment Program (PNIH) for the period 2010-2022. This program aims to improve sustainable access to drinking water in urban and peri-urban areas in Côte d'Ivoire (MINHAS, 2022). The cancellation rate remained virtually zero in 2010 and 2022. However, this rate increased by 10% in 2015. This could be explained by a crisis of confidence and/or irregular service linked to the discontinuity of SODECI's water service, leading to cancellations (Grafton et al., 2019). The number of hours of water service has fallen from 13 hours in 2010 to 10 hours in 2022. The production deficit rate has increased from 32% in 2010 to 50% in 2022. These results attest to a structural gap between the population's water needs and the volumes of water distributed by the network. Indeed, recent studies confirm that the reduction in service hours and the increase in the production deficit rate are the result of a mismatch between growing demand and actual distribution capacity (AfDB, 2020).

The pressure profile of the Yopougon-Kuwait network is characterized by extreme amplitude (-1.25 to 32.1 mCE) and a daily cycle contrasting peaks (nighttime/midday) and troughs (morning/evening). These variations reflect typical behavior in water distribution networks under the influence of socio-economic demand (Alvisi and Franchini, 2018). Indeed, pressure peaks (night and midday) correspond to periods of low demand. Conversely, pressure troughs (morning and evening) are caused by peaks in domestic consumption (Buchberger et al., 2003). These observations are consistent with those of Haque and Rahman (2016), who highlight extreme pressure fluctuations, with critical drops at peak times, particularly in the morning and evening. This study also highlights that urban density exacerbates the problem and creates marked spatial disparities between the center and the peripheries. Furthermore, the high spatial heterogeneity of stratified pressures in areas of high pressure (Johannesburg), intermediate pressure (Ravin, Konan Ferrand), and low pressure (Sous-Koweït, Gouro, Sante extension (Sikasso)) indicates profound inequalities in access to drinking water services. Indeed, stratification of networks into classes according to pressure (high, medium, low) is common in poorly balanced networks, as observed in Nairobi (Kenya) and Dhaka (Bangladesh) (Mutiku et al., 2014; Haque and Rahman, 2016). However, the virtually zero pressures observed in the networks in the Gouro and Sante Extension (Sikasso) areas reflect a hydraulic imbalance. According to Jadhav et al. (2016), persistent near-zero pressures in the Mumbai and Karachi networks reveal not only a hydraulic imbalance but also an acute health risk. Indeed, the negative pressure measured in Sante Extension (Sikasso) (-1.25 mCE) is a critical indicator of health risk.

CONCLUSION

Performance analysis shows poor hydraulic performance of the network, particularly in terms of efficiency and water losses. Despite increased access to drinking water and subscriber density, network performance remains inadequate. Indeed, the decline in specific consumption, combined with a reduction in service hours and a growing production deficit, reveals a persistent mismatch between demand and distribution capacity.

The Yopougon-Kuwait network is characterized by a pressure profile fluctuating between -1.25 and 32.1 mCE with peaks (nighttime/midday) and low periods (morning/evening). In addition, its high spatial heterogeneity of stratified pressures in areas of high pressure (Johannesburg),

356 intermediate pressures (Ravin, Konan Ferrand), and low pressures (Sous-Kuwait, Gouro,
357 Sante extension (Sikasso)) indicates profound inequalities in access to drinking water services.
358
359

UNDER PEER REVIEW IN IJAR

REFERENCES

- Alegre H., Silva R. & Pereira L. (2022). Impact of pipe aging on hydraulic performance and water quality in urban distribution networks. *Water Research*, 215: 118-223.
- ANBT (2020). Les barrages, une solution au manque d'eau : cas du barrage de Bouhamdane (Nord-Est Algérien) (Working Paper). SNV.STU. Availableat:<https://dspace.univ-guelma.dz/jspui/handle/123456789/10926>.
- Angueletou-Marteau L. (2009). Étude sur les stratégies compensatoires des ménages pour l'accès à l'eau dans les quartiers urbains d'Abidjan. Thèse de doctorat en Géographie, Université de Cocody, Abidjan (Côte d'Ivoire), 242 p.
- BAD (2020). Modélisation hydraulique du réseau d'adduction d'eau potable (AEP) de la ville de Korhogo. *International Journal of Innovation and Scientific Research*, 52 (1), 161-177.
- AfricanDevelopment Bank (AfDB) (2016). Côte d'Ivoire – Programme d'urgence pour la restauration des services sociaux et administratifs de base (PURSSAB). Rapport final, Abidjan (Côte d'Ivoire), 120 p.
- Blarel L. & Merzouk A. (2005). Gestion et optimisation des réseaux d'eau potable : indicateurs et méthodes d'évaluation. *Revue des Sciences de l'Eau*, 18(4) : 345-360.
- Demassue L. G. (1994). Quantification of water losses and performance analysis of drinking water supply systems in northern Algeria-case study in the Medea region. *Studies in Engineering and Exact Sciences*, 5 (1), 242-256.
- Goé B.S., Dao A., Akahoua B.D., Koffi J.T., Koffi E.S., Ouédé G.B., Brou L.A., Kamagate B., Kouassi K.L. (2025). Dynamics in salinity diffusion influenced by anthropogenic pressures and climate change: a case study of the Aghien lagoon (Abidjan, Côte d'Ivoire). *International Journal of River Basin Management*, 1–14.<https://doi.org/10.1080/15715124.2025.2477791>
- Goé B.S., Dao A., Akahoua B.D., Koffi J.T., Kamagate B., & Kouassi K.L. (2024). Dynamique de diffusion de la salinité dans la lagune Aghien (Abidjan, Côte d'Ivoire) sous l'influence des prélèvements. *XVIIIèmes Journées Nationales Génie Côtier – Génie Civil*, Anglet, 24–26 June 2024. Editions Paralia CFL, 737–742.<https://doi.org/10.5150/jngcgc.2024.075>.
- Grafton A., Jardine L., & Rosenberg D. (2019). Forgers and Critics, New Edition : Creativity and Duplicity in Western Scholarship. *Presses de l'Université de Princeton*, 1-192.
- Thompson A., Hansen J., Sato M., Nazarenko L., Ruedy R., & Lacis A. (2002). Climate forcings in Goddard Institute for Space Studies SI2000 simulations. *Journal of Geophysical Research: Atmospheres*, 107 (D18).
- INS (2021). Recensement de la population et d'habitat. Rapport du RGPH, Abidjan (Côte d'Ivoire), 37 p.
- Kleiner Y. & Rajani B. (2001). Pipe deterioration modeling and its use in water distribution system management. *Journal of Infrastructure Systems*, 7(4) : 160-169.
- N'cho J. A. (2021). Amélioration du rendement de réseau par la réduction des pertes physiques. *Int. J. Biol. Chem. Sci.* 15(7): 101-119
- Krayenbühl N. (1993). De novo versus transformed atypical and anaplastic meningiomas: comparisons of clinical course, cytogenetics, cytokinetics, and outcome. *Adduction en Eau Potable*, 61 (3), 495-504.
- ONEP (2020). ONEP bilan des activités 2020 - ONEP - Office National de l'Eau Potable. . Consulté 8 juillet 2025, à l'adresse <https://onepci.net/onep-bilan-des-activites-2020/>
- SODECI (2022). Statistiques internes sur la desserte en eau potable à Yopougon-Koweït. Abidjan (Côte d'Ivoire), 34 p.

- Ta bi Boti J., Kouadio K. & N'Guessan K. (2019b). Économie d'eau des toilettes, une approche crédible de réduction du déficit en eau potable à Abidjan (Côte d'Ivoire). *International Journal of Biological and Chemical Sciences*, 13(3) : 1234-1248.
- UN Water (2019). Leaving no one behind. Rapport mondial sur la mise en valeur des ressources en eau, New York (États-Unis), 114 p.
- UN Water (2023). Rapport mondial sur la mise en valeur des ressources en eau. Consulté sur <https://www.unwater.org/>.
- YAO B. D. (2022). Problématique de l'approvisionnement en eau potable à Abidjan (Côte D'Ivoire). *Cahiers Géographiques de l'Ouest*, 10 : 26-27.

UNDER PEER REVIEW IN IJAR